
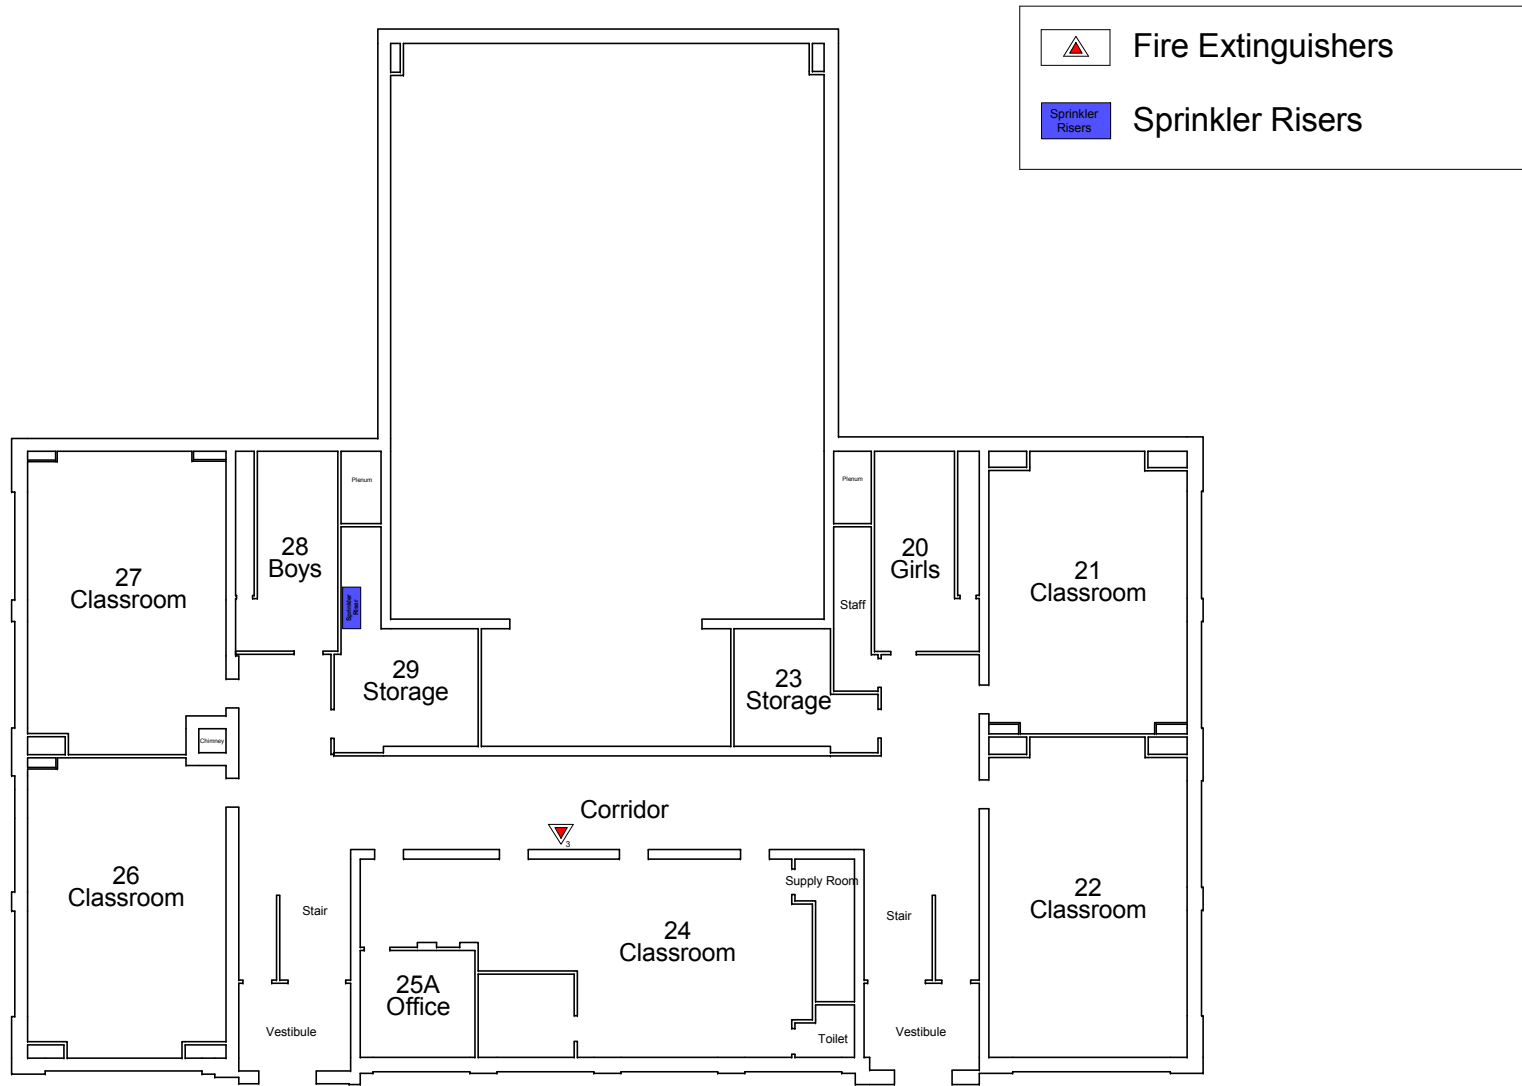





	Wilson ALC	3/21/2015	
	Basement - Fire Extinguishers	1" = 20'-0"	



	Wilson ALC	3/21/2015	
	Level 1 - Fire Extinguishers	1" = 20'-0"	

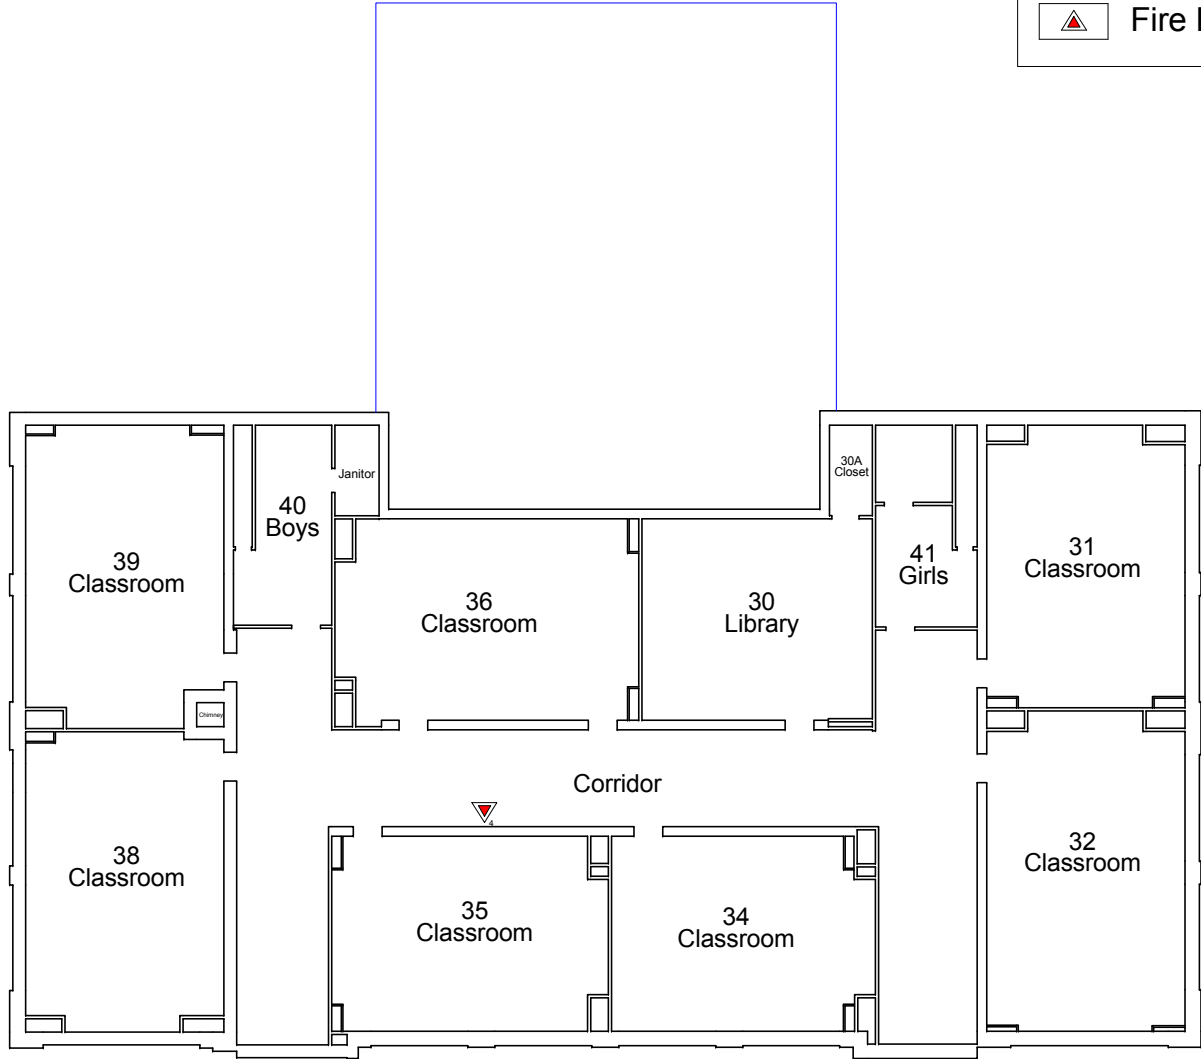

 Fire Extinguishers



	Wilson ALC	3/21/2015	
	Level 2 - Fire Extinguishers	1" = 20'-0"	

Fire Extinguishers

ID Number	Rm Number	Rm Name	Comments	MFG ID	Size	Class	Type	Serial #	New	Last Hydro	Next Hydro	Last 6 Year	Next 6 Year	Aug 14 Service
1	15A	Work Room		Amerex	10#	BC		NU-924929	1997	2012	2024		2018	X
2	.	Kitchen		Amerex	5#	ABC	DC	HE-591377	1987	2012	2024		2018	X
3		Corridor	By Room 24	Amerex	5#	ABC	DC	NM-530826	1996	2008	2020	2014	2026	6 Year
4		Corridor	By Room 34	Amerex	5#	ABC	DC	HE-591376	1987	2009	2021		2015	X
5	19	Boiler Room	Upper Boiler Room Storage	Amerex	5#	BC	CO2	P-485721		2012	2017	NA	NA	X

	Wilson ALC	3/21/2015	
	Fire Extinguisher Schedule		